


AKO Three-Way-Temperature Regulator
 Type Series 226G1121 with manual override
 Deliverable size: 200 mm

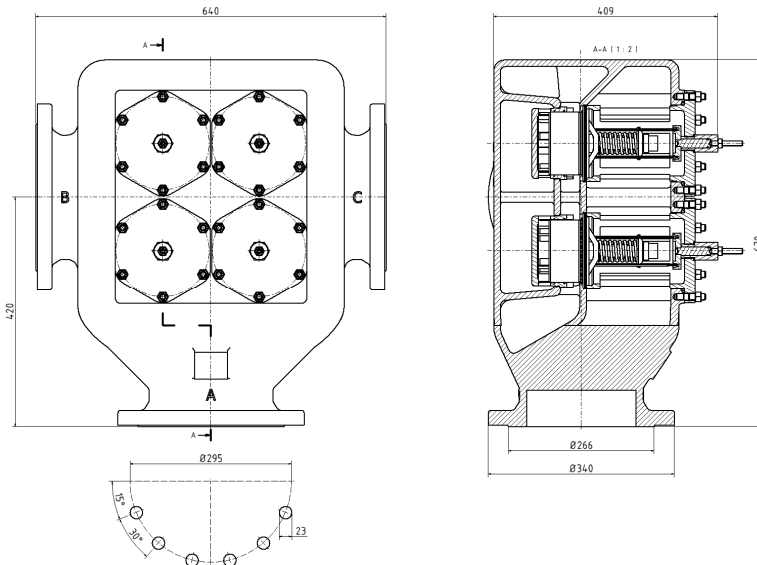

Technical Data:

Material:	
- Body	EN-GJS-400-15
- Inner Parts	SS / Brass
Thermostat	237.1121-xxx
Sealing Kit	NBR
Operating Pressure	up to 16 bar
Adm. Differential Pressure	up to 16 bar
Nominal Pressure	PN 16
Connection	Flange EN 1092-2 form B

Manual override for the mechanical opening of the cooling path in case of any failure of the thermostat.
The emergency adjustment is not to be used to adjust the set point when the thermostat is working properly!

Installation:

The installation can be done selectively as follows:

as divider

- path A: from motor
- path B: to bypass
- path C: to cooler

as mixing valve

- path C: from cooler
- path B: from bypass
- path A: to motor

The paths have been marked on the connections.
 The temperature regulator may be installed in all position.

Deliverable temperature ranges:			
20 – 32 °C	35 – 47 °C	43 – 57 °C	85 – 95 °C
27 – 37 °C	38 – 49 °C	51 – 62 °C	
31 – 44 °C	40 – 52 °C	57 – 68 °C	

max. continuous temperature 25°C above fully open temperature.

Application

AKO Temperature Regulators are suitable for the stabilization of temperatures of media (e. g. water, oils, etc.) and are even applicable as dividing units or mixing valves. Depending on their construction they are distinguished by their low need of maintenance, particular operating convenience and resistance to pressure. A replacement of inner parts is possible on the spot without having to remove the regulating valve from the piping. A faulty assembly can be excluded. The temperature regulators could be assembled in each fitting position.

Function

AKO Temperature Regulators are being equipped with easily replaceable internal wax-filled thermostats that absorb the temperature of the medium surrounding them at the measurement point namely into expansion and thus a change in path or length (the valve stroke). AKO Temperature Regulators do not require any auxiliary energy. At rising temperature and on excess of the opening temperature, the tube slider is being lifted off on the valve seat and opening path A to C, with the path A to B locking simultaneously in the same ratio. The change is being performed in proportion to the change of temperature of the passing medium.

Manual Override: In order to meet the security demands of the classification societies for great safety, the manual override was installed. It is not intended for setting the temperature when the regulating valve runs automatically. The manual resetting facility makes it possible to use the control valve as a manual change-over valve. The taper can be brought into any desired position by means of an adjusting screw, so that any operating temperature can be set by observing the thermometer.